



White - Borough

Yellow - Resident

Pink - DPW

BOROUGH OF RIVER EDGE - BUILDING DEPT
705 KINDERKAMACK ROAD, RIVER EDGE, NJ 07661

SIDEWALK, CURB & APRON CONSTRUCTION/REMOVAL PERMIT

JOB SITE LOCATION: _____

Homeowner Name: _____ Telephone #: _____

CONTRACTOR INFORMATION

Jobsite Contact: _____ Contact #: _____

Company Name: _____ Telephone #: _____

Address: _____

Contractor License #: _____ Email: _____

Type of work: Sidewalk _____ Curb _____ Apron _____

Number of Slabs to be replaced: _____ Curb Amount in Feet _____ Apron Size _____

Applicant's Signature: _____ Date: _____

This applicant certifies that all statement and information made and provided as part of this application are true to the best of the applicant's knowledge, information and belief. The applicant further states that they have been supplied a copy of the specifications for the proposed work.

Applicant has read, understood and agrees with the Borough of River Edge Ordinance chapter 362-Streets & Sidewalks.

Sidewalk replacement due to tree(s)? yes ☐ no ☐

- DO NOT WRITE BELOW THIS LINE -

CALL DPW TO SCHEDULE REQUIRED INSPECTIONS AT: (201)599-6275

Tree Location _____ Tree Location _____ Tree Location _____

Remove ☐
Grind Root ☐

Remove ☐
Grind Root ☐


Remove ☐
Grind Root ☐

Approved by: _____ Date: _____


Note: Slabs must be removed and tree evaluations must be completed prior to sidewalk/curb/apron replacement.

		APPROVED / DENIED		INSPECTOR & DATE
SIDEWALK CORRECT FORM BASE PREPARATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	
EXPANSION JOINTS, BRUSHED FINISHED & EDGED, RESTORATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	
CURB CORRECT FORM BASE PREPARATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	
EXPANSION JOINTS, BRUSHED FINISHED & EDGED, RESTORATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	
APRON CORRECT FORM BASE PREPARATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	
EXPANSION JOINTS, BRUSHED FINISHED & EDGED, RESTORATION	1st	APPROVED	DENIED	
	2nd	APPROVED	DENIED	

Office Use Only: Check # _____ Cash _____ Received by _____

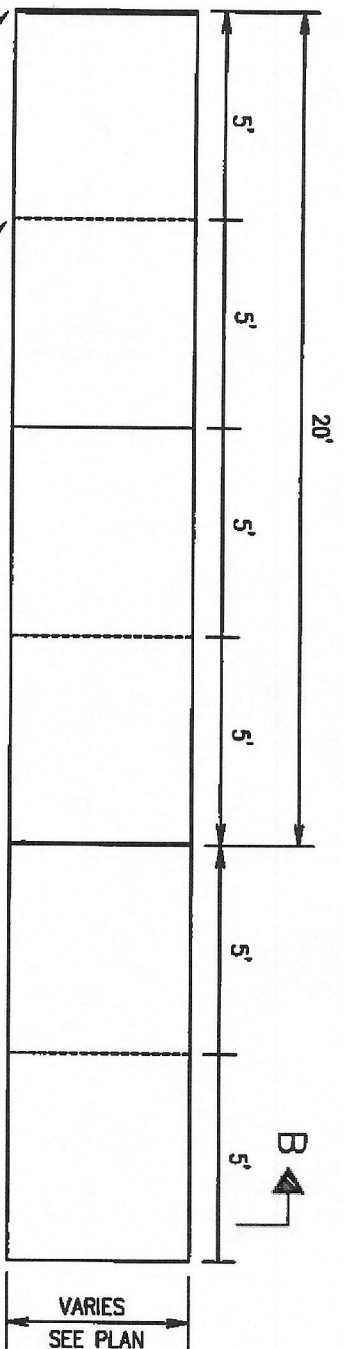


PLAN VIEW

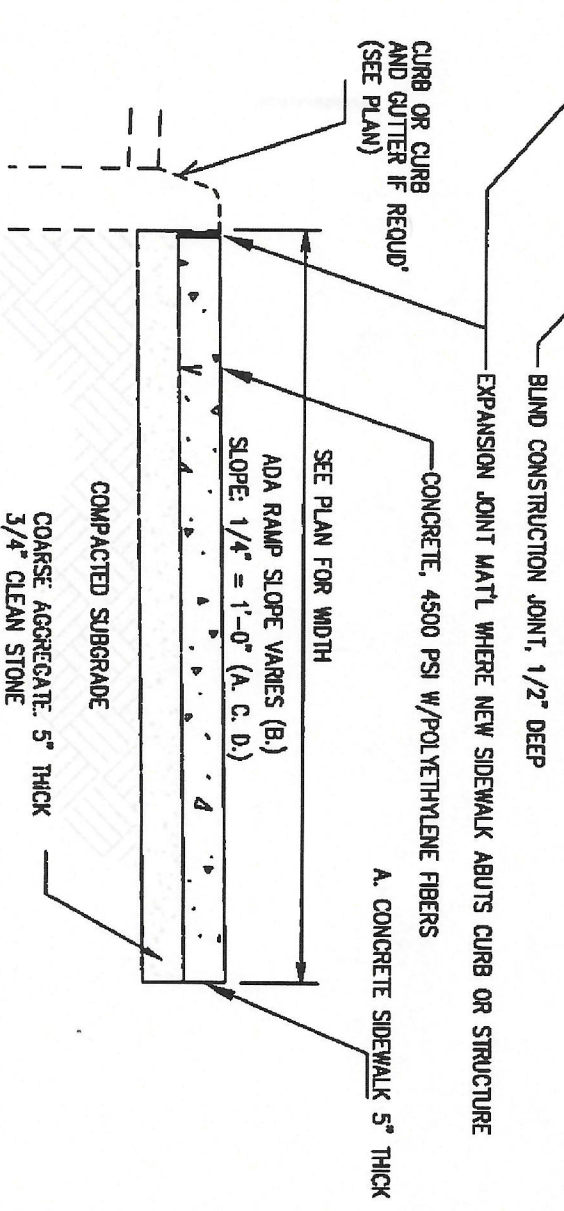

CONCRETE SIDEWALK DETAIL

*** APPLICANT HAS READ, UNDERSTOOD AND AGREES WITH THE BOROUGH OF RIVER EDGE'S ORDINANCE-CHAPTER 362-STREETS AND SIDEWALKS



COMPANY/NAME: _____

SIGNED: _____


DATE: _____

NOTES:


ALL CONCRETE SIDEWALKS, DRIVEWAY, PAVERS APRONS AND CURBING SHALL BE TREATED WITH SOLVENT-FREE SILOXANE EMULSION CONCENTRATE CONCRETE SEALER, SIKAGARD 701W OR EQUAL IS AN ACCEPTABLE PRODUCT. ALL CONCRETE ON THE PROJECT SHALL CONTAIN POLYPROPYLENE FIBERS.
FIBER MIX: 1 LB OF POLYPROPYLENE FIBERS PER 1 CY OF CONCRETE

NOTE: TRANSVERSE JOINTS 1/2" WIDE SHALL BE INSTALLED 10'-0" APART & SHALL BE FILLED WITH PREFORMED BITUMINOUS JOINT FILLER AASHO DESIGNATION M 213 RECESSED 1/4" FROM TOP & FACE

BOROUGH OF RIVER EDGE
SIDEWALK, APRON & CURB REPLACEMENT SPECIFICATIONS

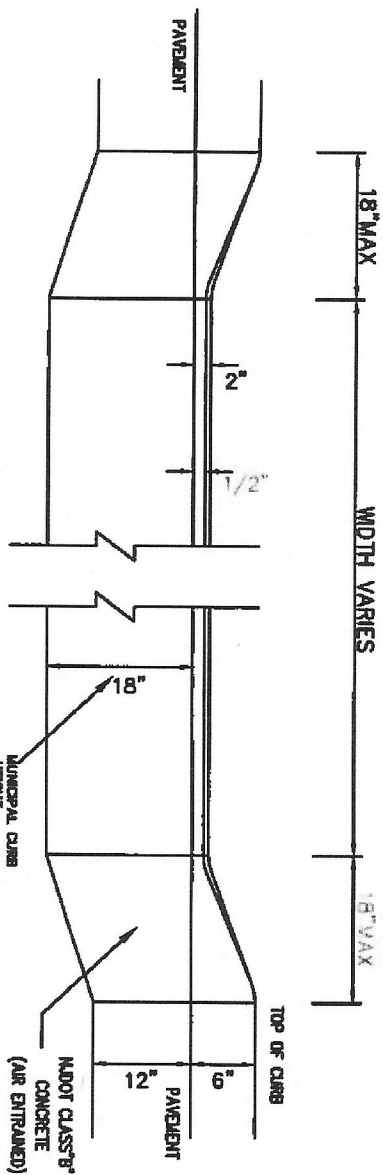

NOTES:
ALL CONCRETE SIDEWALKS, DRIVEWAY, PAVERS APRONS AND CURBING SHALL BE TREATED WITH SOLVENT-FREE SILOXANE EMULSION CONCENTRATE CONCRETE SEALER, SIKAGARD 701W OR EQUAL IS AN ACCEPTABLE PRODUCT.
ALL CONCRETE ON THE PROJECT SHALL CONTAIN POLYPROPYLENE FIBERS. FIBER MIX: 1 LB OF POLYPROPYLENE FIBERS PER 1 CY OF CONCRETE

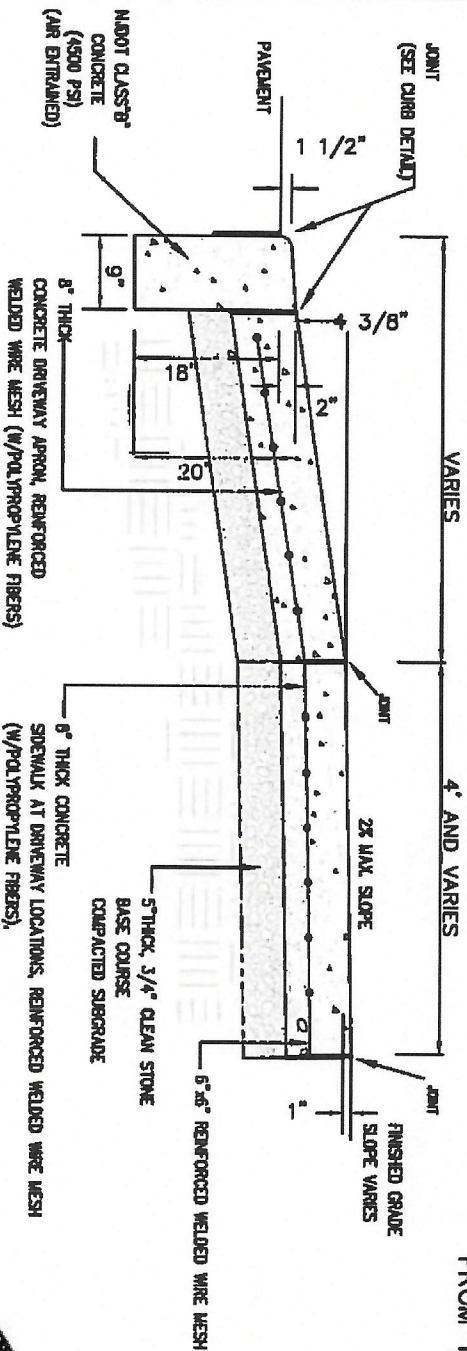


CONCRETE DRIVEWAY DETAIL


*** APPLICANT HAS READ, UNDERSTOOD AND AGREES WITH THE BOROUGH OF RIVER EDGES ORDINANCE-CHAPTER 362-STREETS AND SIDEWALKS

COMPANY/NAME: _____

SIGNED: _____ DATE: _____



BOROUGH OF RIVER EDGE
SIDEWALK, APRON & CURB REPLACEMENT SPECIFICATIONS

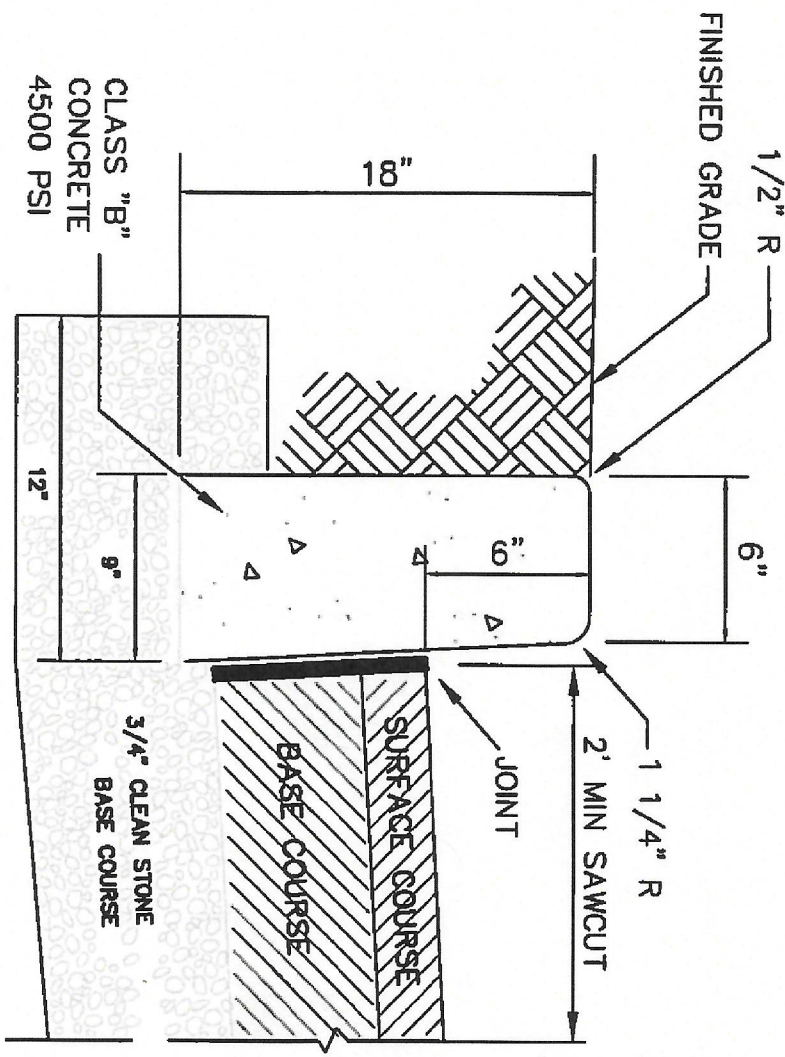


9"x18" VERTICAL CURB DETAIL

*** APPLICANT HAS READ, UNDERSTOOD AND AGREES WITH THE BOROUGH OF RIVER
EDGE'S ORDINANCE-CHAPTER 362-STREETS AND SIDEWALKS

COMPANY/NAME: _____

SIGNED: _____ DATE: _____



BOROUGH OF RIVER EDGE
SIDEWALK, APRON & CURB REPLACEMENT SPECIFICATIONS

NOTES:
ALL CONCRETE SIDEWALKS, DRIVEWAY, PAVERS
APRONS AND CURBING SHALL BE TREATED
WITH SOLVENT-FREE SILOXANE EMULSION
CONCENTRATE CONCRETE SEALER. SIKAGARD
701W OR EQUAL IS AN ACCEPTABLE PRODUCT.
ALL CONCRETE ON THE PROJECT SHALL
CONTAIN POLYPROPYLENE FIBERS.
FIBER MIX: 1 LB OF POLYPROPYLENE FIBERS
PER 1 CY OF CONCRETE

NOTE: TRANSVERSE JOINTS 1/2" WIDE SHALL BE
INSTALLED 10'-0" APART & SHALL BE FILLED
WITH PREFORMED BITUMINOUS JOINT FILLER
AASHO DESIGNATION M 213 RECESSED 1/4"
FROM TOP & FACE